


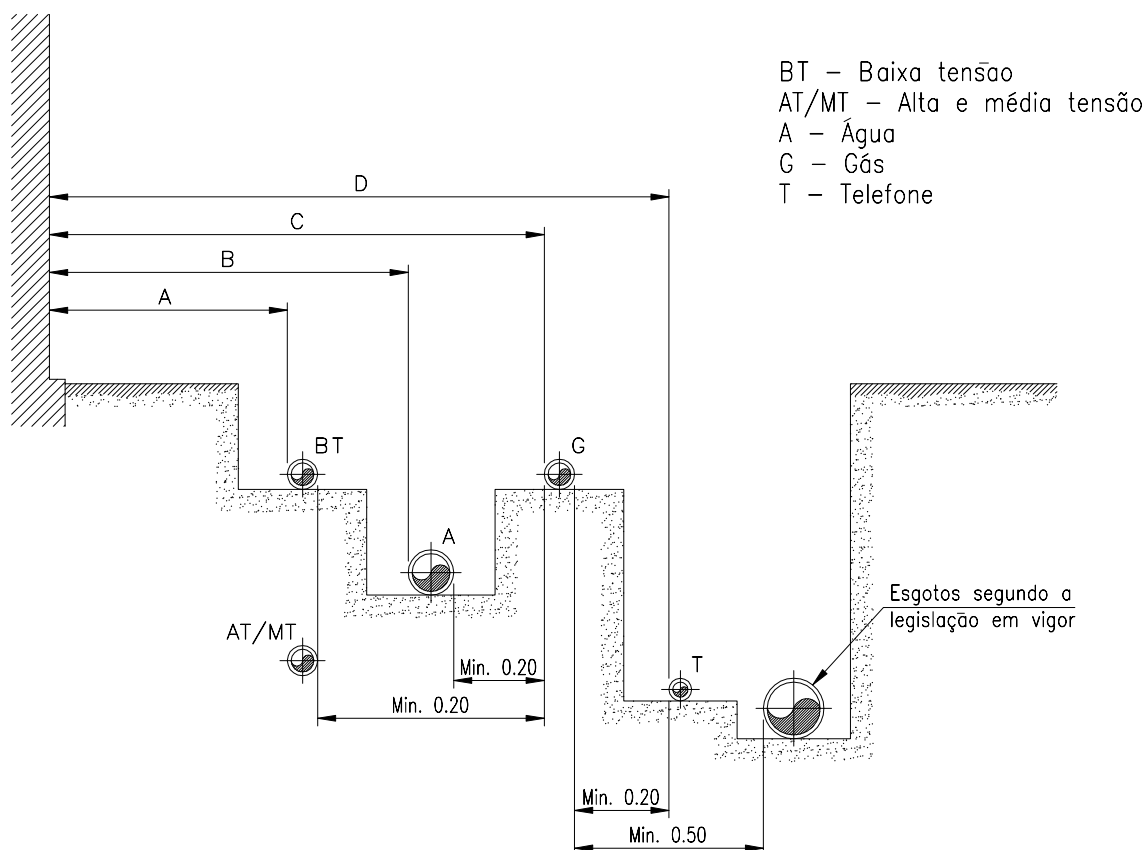

Cotas apresentadas em metros

LARGURA DOS PASSEIOS															
PASSEIOS	0.60	0.70	0.80	0.90	1.00	1.10	1.20	1.30	1.40	1.50	1.60	1.70	1.80	1.90	≥2.00
DISTÂNCIA	A	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.40	0.50	0.50
	B	–	–	–	–	0.80	0.80	0.80	0.80	0.80	0.80	0.80	0.80	0.90	0.90
	C	–	–	–	–	–	–	1.10	1.10	1.10	1.10	1.10	1.10	1.30	1.30
	D	–	–	–	–	–	–	–	–	–	1.40	1.40	1.40	1.60	1.60
PROFUNDIDADE	BT	0.40	0.40	0.40	0.40	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.80	0.80	0.80
	AT	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20	1.20
	A	–	–	–	–	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90	0.90
	C	–	–	–	–	–	–	0.60	0.60	0.60	0.60	0.60	0.60	0.60	0.60
	T	–	–	–	–	–	–	–	–	–	1.20	1.20	1.20	1.20	1.20

Tubagem de distribuição de gás em polietileno (máx. 4 bar)

Lot. Municipal Industrial de Vimioso - Aumento do número de lotes

CÂMARA MUNICIPAL DE VIMIOSO

DATA Fevereiro 2019	ESCALA	PLANTA DA REDE DE ABASTECIMENTO DE GÁS NATURAL UTILIZAÇÃO DO SUB-SOLO - PERFIL TIPO	GN.06
	S/ESC		
	DESENHO		
	ARQUIVO		
	P - 953 / 03 / A		