




ESCALA:
V - 1/100
H - 1/1000

Convenções

Ventosa

Descarga de fundo

Válvula de sectionamento

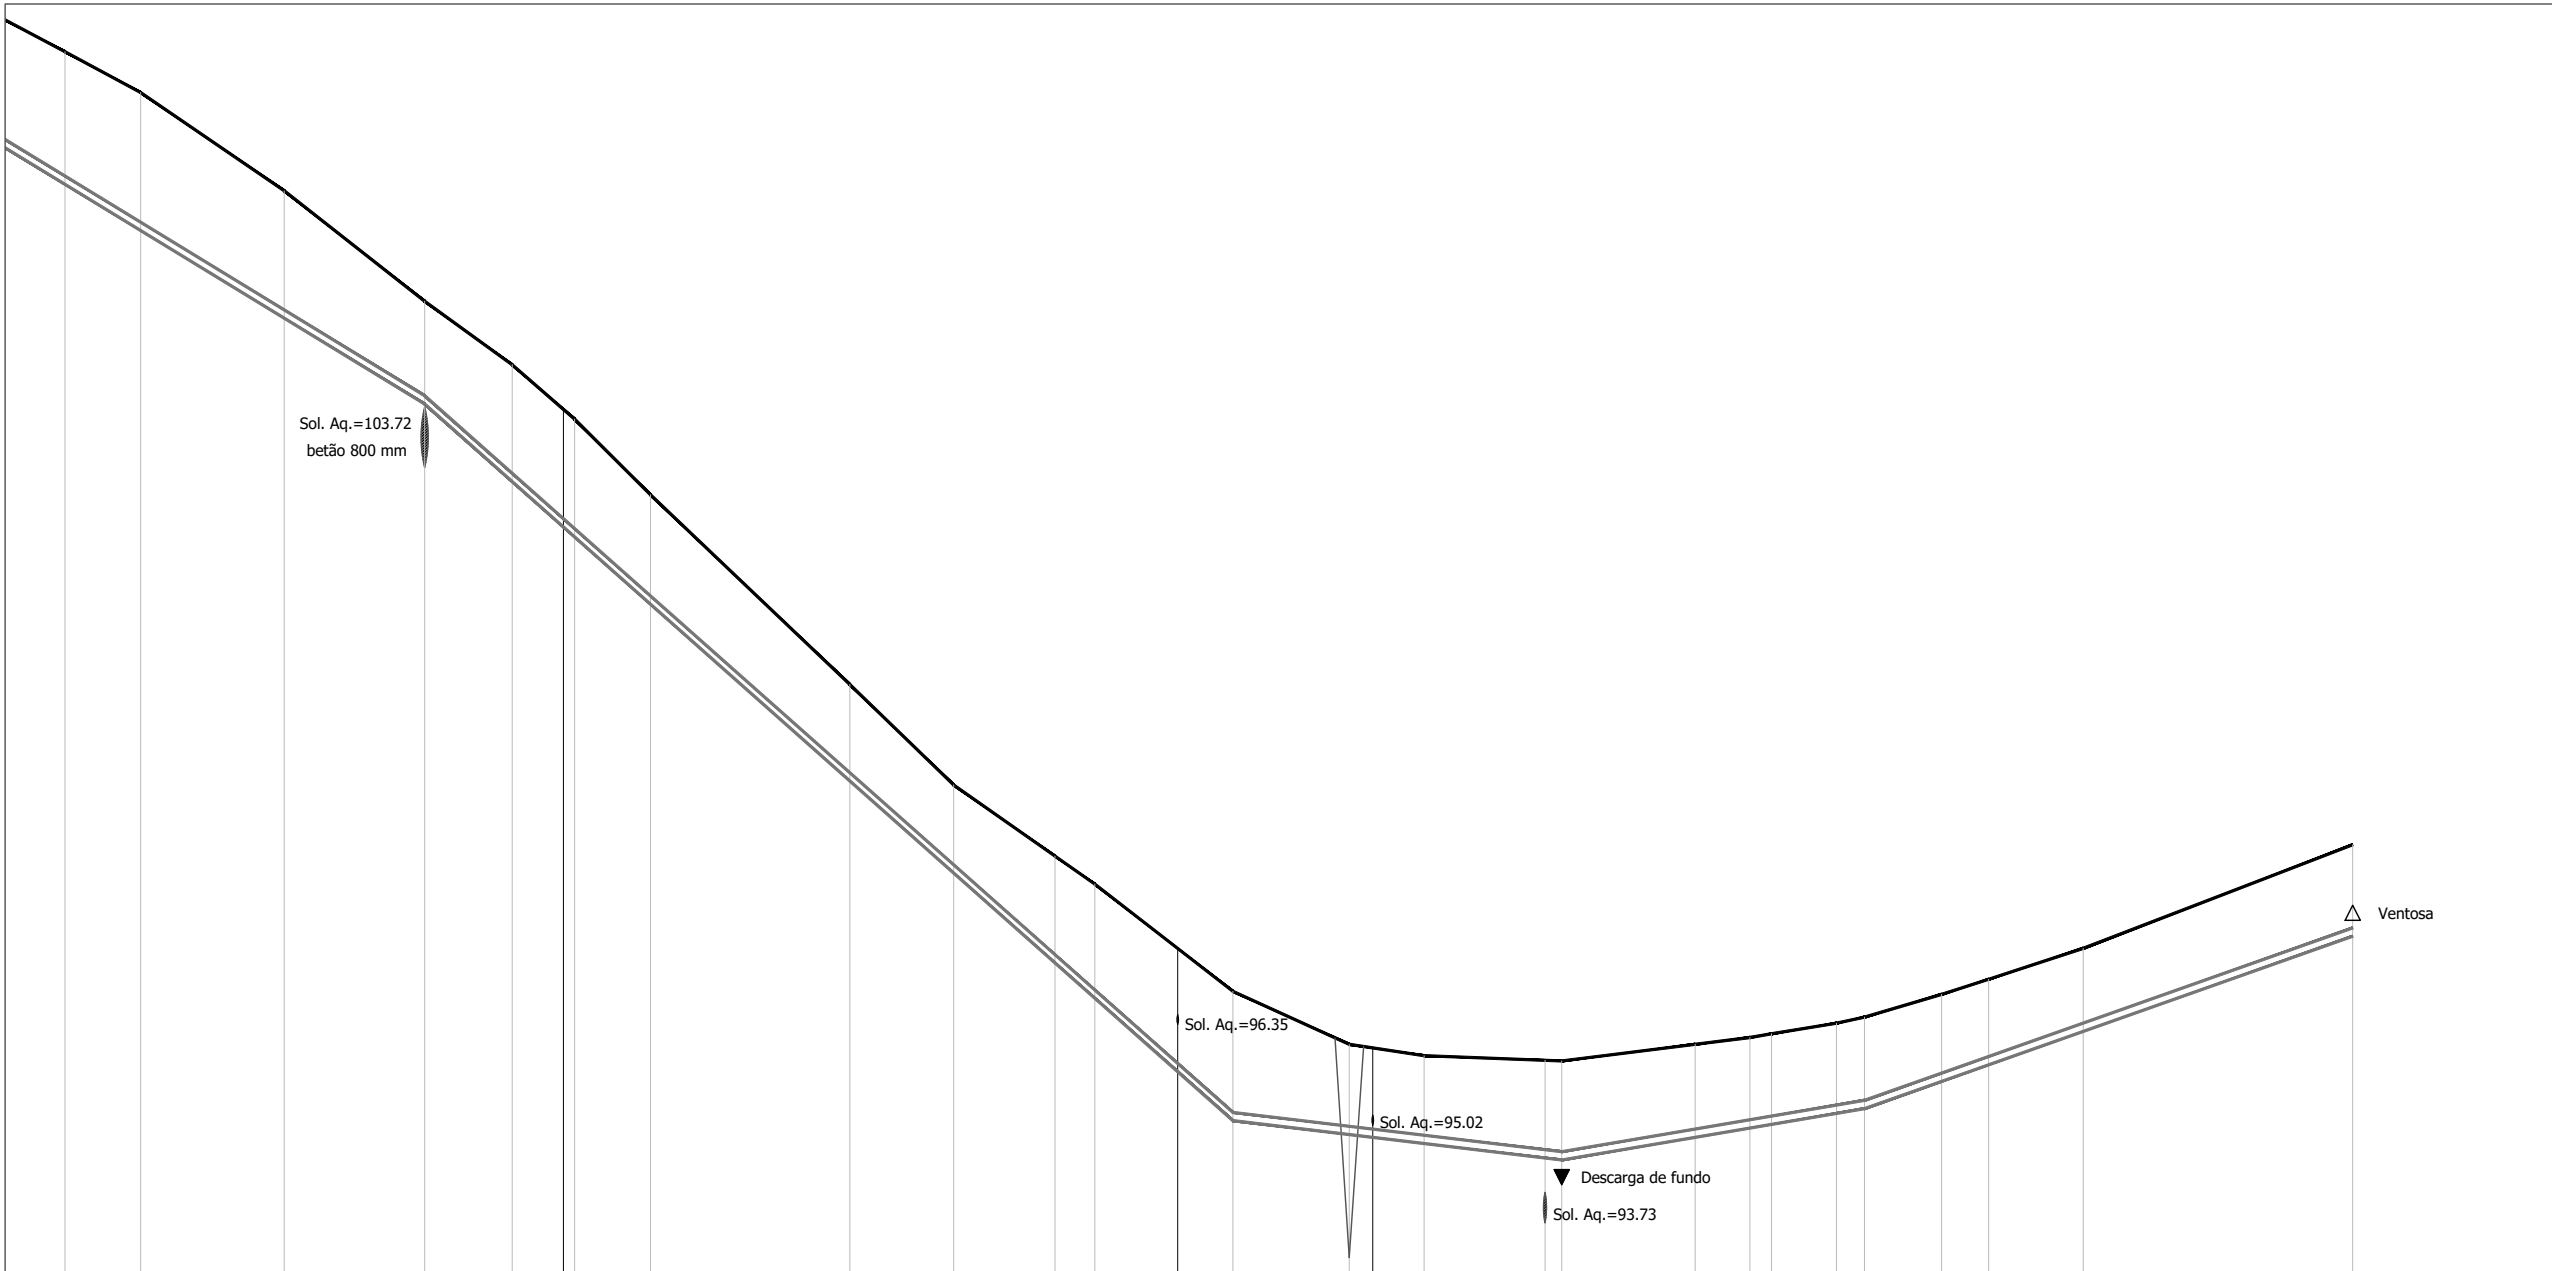

Nº DOS PERFIS		164	165	166	167	168	169	170	171	172	173	174	175	176	177	178	179	180	181	182	183	184	185	186	187
DISTÂNCIAS (M)	PARCIAIS	10.01	19.00	18.57	11.58	8.26	10.03	26.36	13.75	13.39	5.27	18.27	15.39	9.89	18.21	17.65	7.25	2.86	8.58	3.71	10.20	6.22	12.51	35.65	
	À ORIGEM	2316.30	2326.31	2345.31	2356.88	2375.46	2383.72	2393.75	2420.11	2433.86	2447.25	2452.52	2470.79	2486.18	2496.07	2514.28	2531.93	2539.18	2542.04	2550.62	2554.33	2564.53	2570.75	2583.26	2618.91
COTAS (M)	DO TERRENO	109.22	108.68	107.38	105.92	105.08	104.36	103.36	100.85	99.52	98.58	98.21	96.79	96.09	95.94	95.87	96.09	96.18	96.23	96.37	96.45	96.75	96.95	97.36	98.73
	DA SOLEIRA	107.47	106.85	105.69	104.56	103.53	102.80	101.91	99.57	98.35	97.17	96.70	95.08	94.90	94.78	94.56	94.86	94.98	95.03	95.18	95.24	95.60	95.82	96.27	97.52
PROFUNDIDADES À SOLEIRA (M)		1.75	1.83	1.69	1.36	1.55	1.56	1.45	1.28	1.17	1.41	1.51	1.71	1.19	1.16	1.31	1.23	1.20	1.20	1.19	1.21	1.15	1.13	1.09	1.21
MATERIAL E DIÂMETRO DA CONDUTA (MM)		PVC DN 110 PN10																							
ELEMENTOS DO TRAÇADO EM PERFIL										0.088 106.91				0.011 43.49		0.017 40.04		0.035 64.57							

